

- Introduction 147
 - Poles 148
 - Handles **150**
- Configurations 154
- Operating Characteristics 157
 - Delay Curves 159
 - Specifications 163
 - Decision Tables 165







AIRPAX[®] | IAL/CEL/LEL Series Hydraulic Magnetic Circuit Protectors

INTRODUCTION

IAL/IUL/IEL/LEL magnetic circuit protectors provide low-cost power switching, reliable circuit protection and accurate circuit control for equipment in the international marketplace.

IAL models are for those applications where the unit's inherent attributes are desired, but compliance with the various standards is not required.


IUL models have been tested and approved in accordance with UL 1077 requirements for UL recognition.

IEL/LEL models are VDE approved to VDE 0660, part 101. They meet IEC spacing requirements, mandatory for equipment which must comply with IEC specifications 601 and 950, and VDE specifications 0804 and 0805. In addition, the IEL models are UL recognized to UL 1077 as supplementary protectors and the LEL models are UL listed under the conditions of UL 489. Both are CSA certified and CCC Approved. The IEL is CSA certified as a supplementary protector per CSA C22.2–No. 235.


The CEL model has achieved two new enhancements, including a single pole, 125 amp rating with TÜV approval, and a parallel 4-pole version with 400 amp rating.

Airpax[™] IAL/CEL/LEL circuit protectors are available in a wide variety of configurations, including series, series with auxiliary switch, shunt and relay with choice of delays and ratings in DC and/or 50/60Hz or 400Hz versions. Single or multi-pole versions are available with a variety of pole arrangements to meet your specifications. Please see the appropriate product specification table for ratings and limitations.


SINGLE POLE, STANDARD STUD TERMINAL



Single Pole



Screw Terminal



Notes:


Tolerance ± .015 [.39] unless noted.

Dimensions in brackets [] are millimeters.


- A Terminal protrusion dimensions are referenced from back of mounting panel.
- B Each screw terminal is supplied with a 10-32x.312 [7.92] or M5 x 8mm screw, flatwasher and external tooth lockwasher.
- C Stud terminals are supplied with a flatwasher, external tooth lockwasher and a 10-32 or M5 hex nut (<=70A) (<=50A for LEL),1/4-20 or M6 hex nut (>70A)(>50A for LEL).

STUD TERMINAL TYPES


Screw Stud Thread	Dimension "A"	Dimension "B"		
M6	.510 ± .045 [12.95 ± 1.14]	.652 ± .035 [16.56 ± 0.89]		
1/4 -20	.545 ± .045 [13.84 ± 1.14]	.687 ± .035 [17.45 ± 0.89]		
M5	.510 ± .045 [12.95 ± 1.14]	.652 ± .035 [16.56 ± 0.89]		
10-32	.545 ± .045 [13.84 ± 1.14]	.687 ± .035 [17.45 ± 0.89]		



Panel Mounting Detail Tolerance ±.005 [.13] unless noted.



Bullet Terminal



Bullet terminal receptacle should be .312 \pm .001 diameter hole not less than .250 depth. Contact Sensata for other bullet sizes.

Note: Each outer terminal is supplied with a flatwasher, tooth lockwasher and a hex nut.




MULTI-POLE CIRCUIT PROTECTORS

Multi-pole units are combined in an assembly with the trip mechanisms internally coupled. A fault in any protected circuit opens all poles simultaneously. Applications include use in polyphase circuits, single-phase three-wire systems, or in two or more related but electrically isolated circuits. A mix of delays, ratings and configurations are offered. The auxiliary switch is offered with either gold or silver contacts and is available when a series construction pole is specified.


Two Pole Units


An assembly consisting of two single pole units, having their trip mechanisms internally coupled, is available with either a single toggle handle or with a handle per pole. Please see decision one of the part number decision tables. Individual poles may vary in ratings, delays and internal configurations. If the poles are of series construction, an auxiliary switch may be included in either or both poles, allowing you to mix SELV and hazardous voltages.



IELH11

IEL11






Note: Tolerance ± .015 [.38] unless noted. Dimensions in brackets [] are millimeters.

Two Pole*

M6 .510 .652 1/4 - 20 .545 .687 M5 .510 .652 .545 .687 10 - 32 Dim. "A' Screw stud Dim. "B" (± .045) thread (±.035)

Note:

Each outer terminal is supplied with a flatwasher, tooth lockwasher and a hex nut.



Two Pole*

Panel Mounting Detail Tolerance ±.005 [.13] unless noted.

Note:


- A Terminal protrusion dimensions are referenced from back of mounting panel.
- B Each screw terminal is supplied with a 10-32x.312 [7.92] or M5 x 8mm screw, flatwasher and external tooth lockwasher.
- C Stud terminals are supplied with a flatwasher, external tooth lockwasher and a 10-32 or M5 hex nut (<=70A), 1/4 -20 or M6 hex nut (>70A).

Three Pole and Four Pole Units


The three pole structure consists of three single pole units assembled with an internal mechanical interlock which actuates all units simultaneously. The units are available with either a single toggle handle or with a handle per pole. Units with four pole construction operate with a minimum of two center toggle handles or with a handle per pole. Please see decision one of the part number decision tables. Mixing of delays, ratings and configurations is available in each individual pole. The auxiliary switch is offered in any series trip pole.

Breaker poles are numbered consecutively when viewed from the terminal side, with the ON position up, starting with pole #1 on the left side and proceeding to the right.


Three Pole IEL111




Three Pole IELH111



Four Pole IEL1111




Four Pole IELH1111




Panel Mounting Detail Tolerance ±.005 [.13] unless noted.


Mounting Detail*








Mounting Detail*




Mounting Detail*



BX - FLAT ROCKER HANDLE

The innovative new design of our IAL/CEL/LEL BX Style circuit protectors features a flat rocker that will satisfy your aesthetic needs while guarding against accidental actuation, providing the highest degree of circuit protection and quality. Only Airpax offers this new standard in user interface. Available on a variety of versions with a full range of agency approvals, the IEL BX style circuit protectors meet or exceed all current performance specifications, including interrupting capacities up to 50,000 amperes.

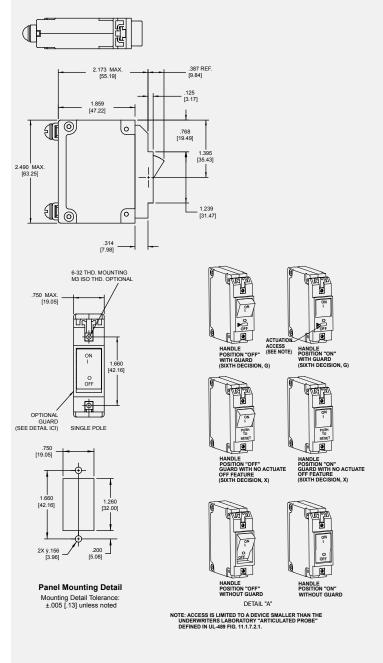

Note:


Tolerance \pm .015 [.39] unless noted. Dimensions in brackets [] are millimeters. *See Single Pole Mounting Detail for Hole Sizes and Locations.



LELHP/CELHP CIRCUIT PROTECTORS

The Airpax[™] LELHP/CELHP high current magnetic circuit protector compliments our entire series of LEL circuit protectors. Its unique, parallel current sensing design provides precise current overload protection and reliability in the compact size of a two pole LEL. The unit is ideal for high power DC applications such as drive motor systems and telecommunication power systems.

LEL is available in series and series with auxiliary switch configurations with a choice of delays for DC ratings of 125, 150, 175 and 200 amperes. The CEL has been enhanced to include these same ratings plus a 4-pole, parallel 400 amp rating for UL489A. The LELHP is UL listed under the conditions of UL489 and CSA certified. The CELHP is UL listed under the conditions of UL489A. Mid-trip handle indication, voltage trip and remote operator options complete the LELHP/CELHP circuit breaker series. Please see the individual product tables for approved ratings.

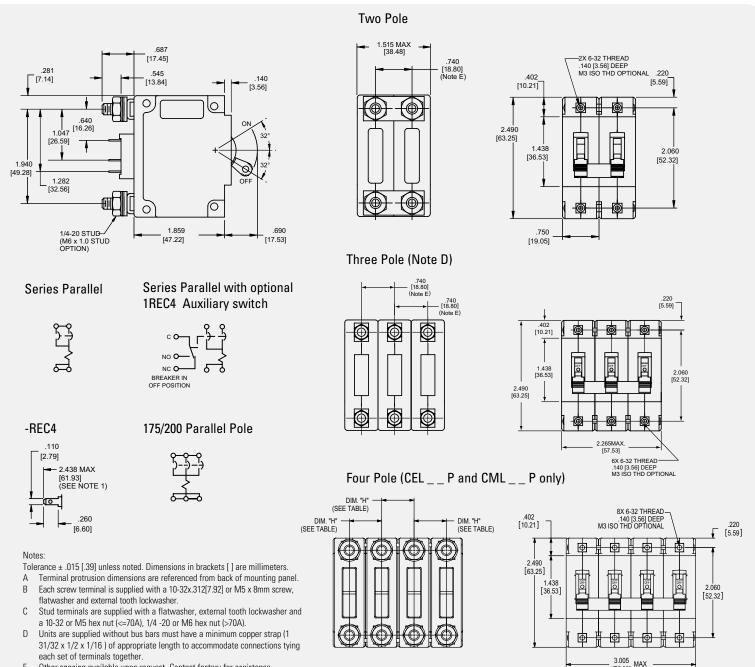

F Other spacing available upon request. Contact factory for assistance.


151

[76.33]


IALN/IULN PANEL SEAL CIRCUIT PROTECTORS

The IALN/IULN family is a sealed toggle version of the IAL/IUL family. The silicone rubber seal around the handle assures panel seal integrity and makes this style a natural for harsh environments.


This sealed toggle family is available in one to three pole models with ratings of .050 to 100 amperes.



Single Pole



Two Pole



(Optional handle may be in pole 2 instead of pole 1.)


Two Pole*

.750 [19.05]


MAX

Panel Mounting Details: Tolerance ±.005 [.13] Unless noted.

Single Pole



Optional handle



*See Single Pole Mounting Detail for Hole Sizes and Locations.


Notes:

- A Terminal protrusion dimensions are referenced from back of mounting panel.
- B Each screw terminal is supplied with a 10-32x.312[7.92] or M5 x 8mm screw, flatwasher and external tooth lockwasher.
- C Stud terminals are supplied with a flatwasher, external tooth lockwasher and a 10-32 or M5 hex nut (<=70A), 1/4 20 or M6 hex nut (>70A).

Three Pole








IAL Series - Handles **152**



IALX/IULX/IELX ROCKER HANDLE

The rocker style is available in one to four poles. Choose either vertical or horizontal mounting with ON-OFF, international markings or a combination of both.


Five front panel enhancing colors including black, white, red, grey and orange are available.



Single Pole

2X 6-32 THD. (TYP.) M3 ISO THD. OPTIONAI 21 42.16]


Two Pole




Three Pole

Four Pole

Panel Mounting Detail* Single, Two & Three Pole



Four Pole**



*Mounting detail tolerance ±.005 [.13] Unless noted. **See single mounting detail for hole sizes and locations.


(Optional handle may be in Pole 2 instead of Pole 1.)

Note:

- Terminal protrusion dimensions are referenced from back of mounting panel. А Each screw terminal is supplied with a 10-32x.312[7.92] or M5 x 8mm screw, R
- flatwasher and external tooth lockwasher.
- С Stud terminals are supplied with a flatwasher, external tooth lock washer and a 10-32 or M5 hex nut (<=70A), ° -20 or M6 hex nut (>70A).


IALZX/IULZX/IELZX ROCKER HANDLE

The IALZX/IULZX/IELZX style adds our rocker handle options of contrasting dual color rocker actuators, affording a clear visual indication of the handle position and integrated handle guards, to help prevent accidental turn-on and turn-off of the unit. Available with a black rocker and white, red or green indicator color for either ON or OFF indication.

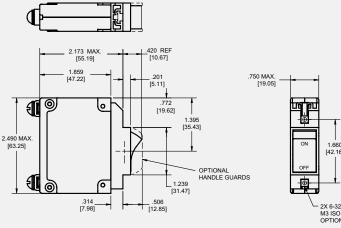

Note: Tolerance ± .015 [.38] unless noted. Dimensions in brackets [] are millimeters.

1.660 [42.16] 2X 6-32 THD M3 ISO THD OPTIONAL Panel Mounting Detail



Panel Mounting Detail Tolerance ±.005 [.13] unless noted.

153

CONFIGURATIONS

Series Trip

The most popular configuration for magnetic protectors is the series trip where the sensing coil and contacts are in series with the load being protected. The handle position conveniently indicates circuit status. In addition to providing conventional overcurrent protection, it's simultaneously used as an on-off switch.

Shunt Trip

The shunt trip is designed for controlling two separate loads with one assembly. The control is established by providing overload protection for the critical load. When the current through this load becomes excessive and reaches the trip point, the protector will open and remove power from both loads simultaneously. The total current rating of both loads must not exceed the maximum contact rating.

Dual Coil

By combining two electrically independent coils on a common magnetic circuit, it is possible to provide contact opening when either an over-current or trip voltage is applied to the respective coils. One coil will be a current trip coil with standard specifications. The second, or dual coil, can be used to provide a control function permitting contact opening from a remote interlock or other transducer functions. Standard coils are 6, 12, 24, 48, 120 and 240 volts. Tripping is instantaneous and must be removed (usually self-interrupting) after trip.

Auxiliary Switch (Applies to Series Trip Only)


This is furnished as an integral part of a series pole in single or multi-pole assemblies. Isolated electrically from the protector's circuit, the switch works in unison with the power contacts and provides indication at a remote location of the protector's on-off status.

Auxiliary switch contacts actuate simultaneously with the main breaker contacts, and will open regardless of whether the breaker contacts are opened manually or electrically. For auxiliary switch ratings below 6Vac or 5Vdc, an auxiliary switch with gold contacts, designated as REG is available. Gold contacts are not recommended for load current above 100 milliamps.


Note:

- A Terminal protrusion dimensions are referenced from back of mounting panel.
- B Each screw terminal is supplied with a 10-32x.312[7.92] or M5 x 8mm screw, flatwasher and external tooth lockwasher.
- C Stud terminals are supplied with a flatwasher, external tooth lock washer and a 10-32 or M5 hex nut (<=70A), 1/4-20 or M6 hex nut (>70A).

Series and Switch Only




Series with Auxiliary Switch




STUD TERMINAL TYPES

Screw Stud Thread	Dimension "A"	Dimension "B"		
M6	.510 ± .045 [12.95 ± 1.14]	.652 ± .035 [16.56 ± 0.89]		
1/4 -20	.545 ± .045 [13.84 ± 1.14]	.687 ± .035 [17.45 ± 0.89]		
M5	.510 ± .045 [12.95 ± 1.14]	.652 ± .035 [16.56 ± 0.89]		
10-32	.545 ± .045 [13.84 ± 1.14]	.687 ± .035 [17.45 ± 0.89]		


Shunt and Dual Coil









Spacing for VDE Switch





Note: Each outer terminal is supplied with a flatwasher, tooth lockwasher and a hex nut.





CONFIGURATIONS (CONT.)


Relay Trip


This permits the overload sensing coil to be placed in a circuit which is electrically isolated from the trip contacts. The coil may be actuated by sensors monitoring pressure, flow, temperature, speed, etc. Other typical applications include crowbar, interlock and emergency/rapid shutdown circuitry. Trip may be accomplished by voltage or current, which must be removed after trip.


Voltage Trip

Sometimes called "dump circuits" or "panic trip circuits," these units make it possible to open main power contacts with lower power inputs from one or more sources. This configuration is becoming increasingly more important for sensitive circuitry and denser packaging in automation systems. Available in series, shunt or relay configurations.

Relay and Dual Coil









Notes:


155

- Tolerance ± .015 [.39] unless noted. Dimensions in brackets [] are millimeters.
- A Terminal protrusion dimensions are referenced from back of mounting panel.
- B Each screw terminal is supplied with a 10-32x.312[7.92] or M5 x 8mm screw, flatwasher and external tooth lockwasher.
- C Stud terminals are supplied with a flatwasher, external tooth lockwasher and a 10-32 or M5 hex nut (<=70A), 1/4 -20 or M6 hex nut (>70A).



















NOTE: THIS BARRIER CAN BE FLIPPED TO COVER EITHER POLE. PLEASE CONTACT FACTORY FOR SPECIFIC PART NUMBER

BARRIER OPTIONS

Rating Option	Standard Barrier	Optional Barrier		
IEL				
240/415 VAC				
415 VAC (VDE)	Fig. 1	Fin 2 2 8 4		
277/480 VAC	Fig. 1	Fig. 2, 3 & 4		
1/4-20, M6 studs for AC				
120/240 VAC multi-pole	Fig. 2	Fig. 2.9.4		
125VDC	Fig. 2 Fig. 3 &			
LEL				
All multi-pole 50/60 Hz	Fig. 2	Fig. 3 & 4		
All multi-pole 80 VDC, if opposite polarity	Fig. 2	Fig. 3 & 4		
125VDC	Fig. 2	Fig. 3 & 4		
Note: Optional barrier available with factory assigned	d part number.	Contact		

Note: Optional barrier available with factory assigned part number. Contact factory for assistance.

ems. Available in series, shunt (

IAL Series - Configurations

Mid-Trip Indication

Circuit protection, rapid fault location and alarm capability are blended together in the Airpax mid-trip indication option. This option is designed for automatic handle movement to a middle position upon electrical overload, allowing for easier detection of the fault circuitand minimizing downtime due to the overload condition.

In the optional auxiliary switch configuration, the switch allows an alarm or signal to be forwarded when the breaker trips and the handle moves to the middle position. The alarm can be disengaged by the manual actuation of the handle to the OFF position. Once the fault has been corrected, the circuit breaker can be reset to the ON position. The mid-trip option is available in one, two or three pole toggle handle packages and in either standard panel screw or snap-in mounting. Please see specification tables of specific product for available ratings.


Snap-In Mounting


The snap-in mounting adapter allows for simplified mounting of most IEL/LEL toggle handle products. Prior to shipment, the adapter is attached to the circuit breaker during our final product assembly, allowing you to securely snap the unit into a rectangular panel cut-out. This eliminates the need for panel mounting hardware and associated assembly costs.

Available for units up to three poles, with or without an option handle guard.

Note: Tolerance ± .015 [.39] unless noted. Dimensions in brackets [] are millimeters.

Panel Mounting Detail Tolerance ±.005 [.13] unless noted.






TRIPPED)


Positions


Mid-Trip Handle




Detail


Panel Mounting





1.750



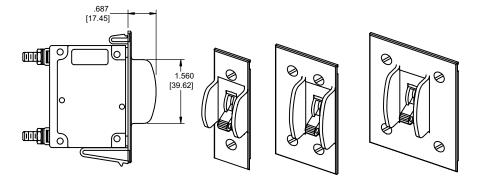

PANEL MOUNTING OPTIONS								
# of Poles	Dimension "A"	Panel Thickness						
1 pole	.760 ± .007 [19.30 ± .18]	.062 ± .005 [1.57 ± .13]						
2 pole	1.530 ± .007 [38.86 ± .18]	.062 ± .005 [1.57 ± .13]						
3 pole	2.280 ± .007 [57.91 ± .18]	.062 ± .005 [1.57 ± .13]						

OPERATING CHARACTERISTICS

NOMINAL DCR /IMPEDANCE Resistance (ohms) Impedance (ohms) Impedance (ohms) **Current Ratings DC Delays** AC, 50/60Hz Delays AC, 400Hz Delays (Amps) 51, 52, 53, 59 41, 42, 43, 49 61, 62, 63, 69 0.20 45.8 28.5 71.94 2.85 1.0 1.38 1.10 2.0 0.371 0.29 0.76 5.0 0.055 0.051 0.12 10.0 0.017 0.016 0.032 0.006 0.006 0.010 20.0 30.0 0.003 0.004 0.006 50.0 0.0019 0.0018 0.0019 0.00157 0.00134 60.0 _ 70.0 0.00147 0.00133 ____ 80.0 0.00146 0.00123 _ 0.00114 0.00135 90.0 _ 100.0 0.00135 0.00114 _____ 125.0 0.0005 ____ ____ 150.0** 0.0005 ____ 165.0** 0.0004 ____ ____ 175.0** 0.0004 ____ ____ 200.0** 0.0004 ____ _ 250.0** 0.0004 ____ ____ 400** 0.0003 ____ ____

Notes:

DCR and impedance based on 100% rated current applied and stablized a minimum of one hour.

No 53 delay on 125 amp single pole or 400 amp four pole devices

Tolerance: .02 amperes to 2.5 amperes, ± 20%; 2.6 amperes to 20 amperes, ± 25%; 21 amperes to 50 amperes, ± 50%. Consult factory for special values and for coil impedance of delays not shown

** Paralleled poles only, 400 amps only available on CELHP

PERCENTAGE OF RATED CURRENT VS TRIP TIME IN SECONDS AT +25°C

Delay	100%	125%*	150%	200%	400%	600%	800%	1000%
41*	No Trip	May trip	.5 to 8	.15 to 1.9	.02 to .4	.006 to .25	.004 to .1	.004 to .05
42*	No Trip	May trip	5 to 70	2.2 to 25	.40 to 5	.012 to 2	.006 to .2	.006 to .15
43*	No Trip	May trip	35 to 350	12 to 120	1.5 to 20	.012 to 2.2	.01 to .22	.01 to .1
49*	No Trip	May trip	.100 max.	.050 max.	.020 max.	.020 max.	.020 max.	.020 max.
51	No Trip	.5 to 6.5	.3 to 3	.1 to 1.2	.031 to .5	.011 to .25	.004 to .1	.004 to .08
52	No Trip	2 to 60	1.8 to 30	1 to 10	.15 to 2	.04 to 1	.008 to .5	.006 to .1
53**	No Trip	80 to 700	40 to 400	15 to 150	2 to 20	.23 to 9	.015 to .55	.012 to .2
59	No Trip	.120 max.	.100 max.	.050 max.	.022 max.	.017 max.	.017 max.	.017 max.
61	No Trip	.7 to 12	.35 to 7	.130 to 3	.030 to 1	.015 to .3	.01 to .15	.008 to .1
62	No Trip	10 to 120	6 to 60	2 to 20	.2 to 3	.02 to 2	.015 to .8	.01 to .25
63	No Trip	50 to 700	30 to 400	10 to 150	1.5 to 20	.4 to 10	.013 to .85	.013 to .5
69	No Trip	.120 max	.100 max.	.050 max.	.022 max.	.017 max.	.017 max.	.017 max
71	No Trip	.44 to 10	.3 to 7	.100 to 3	.030 to 1	.012 to .3	.004 to .15	.004 to .1
72	No Trip	1.8 to 100	1.7 to 60	1 to 20	.15 to 3	.015 to 2	.008 to .79	.006 to .28
73	No Trip	50 to 600	30 to 400	10 to 150	1.8 to 20	.015 to 10	.015 to .88	.011 to .5
79	No Trip	.120 max	.100 max.	.050 max.	.023 max.	.016 max.	.015 max.	.015 max

Notes:

All trip curves and trip currents are specified with the protector mounted in the normal vertical position at ambient temperature of +25° C. Protectors do not carry current prior to application of overload. A: Ratings above 30 amps may deviate from the above limits by approximately 10% (130% for delay 49). * No 53 delay on 125 amp single pole or 400 amp four pole devices * 135% for delay 71, 72, 73 & 79



400Hz, DC, 50/60Hz Delay Curves (typ)


A choice of delays is offered for DC, 50/60Hz, 400Hz, or combined DC/50/60Hz applications. Delays 49, 59, 69 and 79 provide fast-acting, instantaneous tripping and are often used to protect sensitive electronic equipment (not recommended where a known inrush exists). Delays 41, 51, 61 and 71 have a short delay for general purpose applications. Delays 42, 52, 62 and 72 are long enough for most transformers and capacitor loads. Delays 43, 53, 63 and 73 are extra long for special motor applications.


Sensata


Inrush Pulse Tolerance


Pulse tolerance is defined as a single pulse of half sine wave peak current amplitude of 8 milliseconds duration that will not trip the circuit breaker.

The table on page 171 provides a guide to determine if the inertia delay feature is required. Consult factory for further assistance.

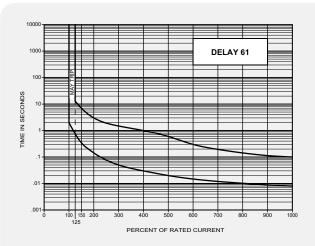

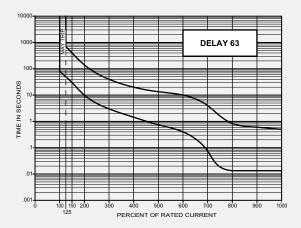


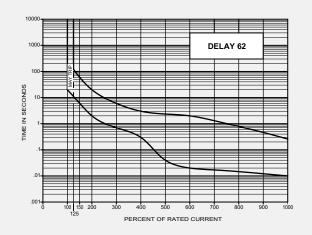


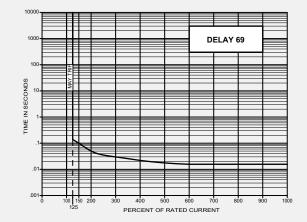



DC Delay Curves (typ)

PULSE TOLERANCES	
Delay	Pulse Tolerance
61, 62, 63, 71, 72, 73	10 times (approx.) rated current
61F, 62F, 63F, 71F, 72F, 73F	12 times (approx.) rated current
64, 65, 66 (0 - 50A)	25 times (approx.) rated current
64, 65, 66 (>50 - 80A)	20 times (approx.) rated current
64, 65, 66 (>80 - 100A)	18 times (approx.) rated current
01,00,00 (200 100A)	To times (approx.) fated current

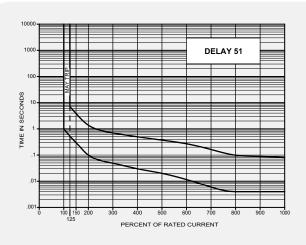

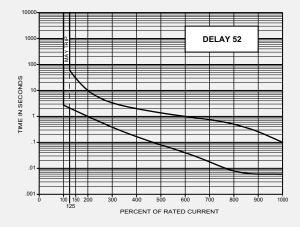


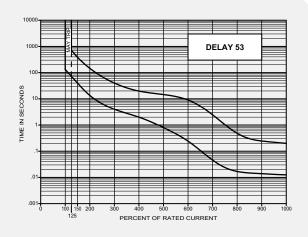


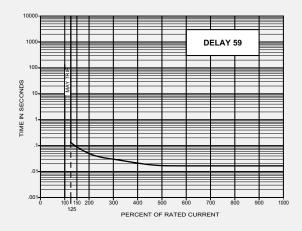





400Hz Delay Curves (typ) *Available only in IAL/IUL/IEL; not available in LEL.






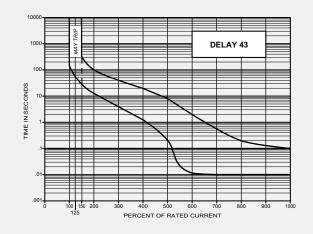


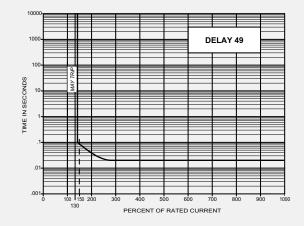



IAL Series

DC/50/60Hz Dual-frequency Delay Curves (typ)

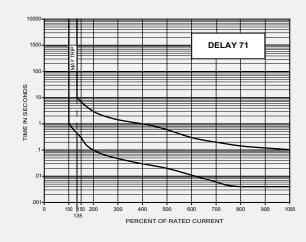

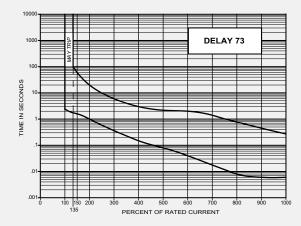

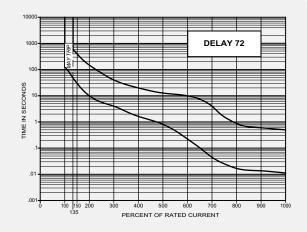

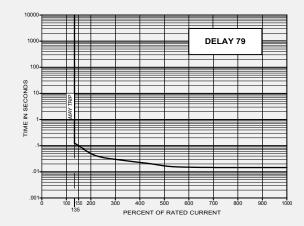



IAL/IUL/IEL/IDL/LEL SPECIFICATIONS

Trip Free

Will trip open on overload even when forcibly held in the ON position. This prevents the operator from damaging the circuit by holding the breaker on.

Trip Indication

The operating handle moves positively to the OFF or mid-trip position on electrical overload.

Ambient Operation

IAL/IUL/IEL protectors operate in temperatures between –40°C to +85°C.

Insulation Resistance

Not less than 100 megohms at 500 volts DC.

Dielectric Strength

IAL/IUL/IEL protectors withstand 3750Vac (1250Vac for LEL), 60Hz for 60 seconds between all electrically isolated terminals except auxiliary switch terminals shall withstand 600Vac, 60Hz for REG and REC types. Four terminal dual coil and relay construction (not offered in the LEL) will withstand 1500Vac.

Endurance

Operating as a switch, the operating life exceeds 10,000 operations, 6000 at rated load, 4000 without load, at a rate of 6 per minute.

Electrical Characteristics

.050-100 amperes 80Vdc, 240Vac Max., 240/415Vac at 50 amperes Max., 50/60Hz and 400Hz. Consult factory for specific product ratings. Units rated for 240/415Vac and above 50 amperes are not suitable for across-the-line motor starting.

Poles

One through six poles available.

Construction

Series, shunt, relay dual coil and series with auxiliary switch available in various delays and combinations.

Auxiliary Switch

When supplied shall be S.P.D.T. configuration. Non VDE approved switches have a maximum UL rating of 10.0 amperes, 250 volts, 60Hz; 3.0 amperes, 50 volts DC (REC type) or 0.1 amperes, 125 volts, 60Hz (REG type).

VDE approved switches have a maximum UL rating of 10.0 amperes, 250 volts, 60Hz (REC type); or 0.1 amperes, 125 volts, 60Hz (REG; type). The maximum VDE ratings are 1.0 amperes, 125 volts, 60Hz (REC type); 0.1 amperes, 125 volts, 60Hz (REG type).

Salt Spray (Corrosion)

Meet the requirements of MIL-PRF-55629 when tested in accordance with Method 101 of MIL-STD-202.

Moisture Resistance

Meet all the requirements of MIL-PRF-55629 when tested in accordance with Method 106 of MIL-STD-202.

Shock

Circuit protectors shall not trip when tested per MIL-STD-202, Method 213, Test Condition I with 100% rated current applied to delayed units and 80% rated current to instantaneous units.

Vibration

Circuit protectors shall not trip when vibrated per MIL-STD-202, Method 204, Test Condition A with 100% rated current applied to delayed units and 80% rated current to instantaneous units.

UL-1500 (Marine Ignition Protected)

The IDL/IDLH is approved for Marine Ignition Protection (series configuration only), covering ignition protected circuit breakers. This specification requires devices to be used in accordance with the requirements of U.S. Coast Guard and Fire Protection Standard for Pleasure and Commercial Motor Craft, ANSI/MFPA #302.

APPROXIMATE WEIGHT PER POLE

Ounces	Grams
3.1	90

RECOMMENDED TORQUE SPECIFICATIONS

Component	Torque (in-lbs)				
6-32 Mounting Inserts	6 to 8				
M3 Mounting Screws	4 to 5				
10-32 Screw Terminals	14 to 15				
M5 Terminal Screws	14 to 15				
10-32 Stud Terminals	13 to 14				
M5 Stud Terminals	13 to 14				
1/4 - 20 Stud Terminals	40 to 45				
M6 Stud Terminals	40 to 45				
1/2 - 32 Mounting Bushing	30 to 35				

Where applicable, mechanical support must be provide to the terminals when applying torque

IAL/IUL/IEL/IDL/LEL/LELHP SPECIFICATIONS

AGENCY APPROVALS - IAL/IUL/IEL

	Frequency		Min.				VDE	UL 1077 & CSA	VDE
Voltage	(Hz)	Phase	Poles	TC	OL	UL/CSA	(amps)	(AIC)	(AIC)
65	DC	-	1	1	1	.02-100	.10-70	U2, 7500	4000
65(4)	DC	-	1	1	1	.02-100	-	U2, 3000	-
65(4)	DC	-	1	1	1	.02-50	-	U2, 5000	-
65	DC	-	2**	2	1	101-150	-	U2, 7500	-
80	DC	-	1	1	1	.02-70	.10-50	U2, 7500	4000
80	DC	-	1	1	1	70.1-100	-	U2, 5000	-
80	DC	-	2	1	1	101-150	-	U1, 10000	-
80	DC	-	3	1	0	251-300	-	U2, 7500	-
125	DC	-	2	1	0	.02-100	-	U2, 5000	-
250	DC	-	2+	1	0	.02-50	-	U1, 5000	-
300	DC	-	3++	1	0	.02-50	.10-50	U2, 1000	5000
125	50/60	1	1	1	0	.02-70	-	U2, 5000	-
125	50/60	1	1	1	1	.02-100	-	U1, 3000	-
125(5)	50/60	1	1	1	1	.02-100	-	U3, 1500	-
120/240	50/60	1	2	2	1	.02-100	-	U1, 2000	-
125/250(5)	50/60	1	2 only	1	1	.02-100	-	U3, 1500	-
240	50/60	1&3	1	1	0	.02-70	-	U1, 2000	-
240	50/60	3	2	1	1	.02-100	-	U2, 2000	-
250	50/60	3	1	1	1	.02-50	.10-100	U2, 3000	2000
250	50/60	3	1	1	1	.02-50	.10-100	C2, 5000(1)	2000
250	50/60	1	1	1	1	.02-50	.10-100	C2, 5000(2)	2000
250	50/60	3	2	1	0	.02-80	.10-100	U1, 1000	2000
250	50/60	3	1	1	0	.02-60	.10-100	U1, 5000	2000
250(5)	50/60	3	3 only	1	1	.02-100	-	U3, 2000	-
277	50/60	1	1	1	1	.02-50	-	U2, 2000	-
277	50/60	1&3	1	2	1	.02-50	-	C2, 5000(1)	-
240/415	50/60	3	2	2	0	.02-50	.10-50	U2, 2000	2000
240/415	50/60	1	2	2	0	.02-50	.10-50	C2, 5000(1)	2000
277/480	50/60	3	2	2	1	.02-30	-	U2, 2000	-
277/480	50/60	3	2	2	1	.02-50	-	U2, 1200	-
277/480	50/60	3	2	1	1	.02-30	-	C2, 5000(3)	-
277480	50/60	1&3	2	1	0	.02-50	-	C2, 5000(3)	-
480	50/60	1&3	2	1	1	.02-30	-	C2, 5000(3)	-
480	50/60	3	2	1	0	.02-50	-	C2, 5000(3)	-
250	400	1&3	1	2	1	.02-50	-	U2, 1500	-

AGENCY APPROVALS - LEL/LELHP

	-	1		í	1.005	1.11.100	1.005
	Frequency		Min.		VDE	UL489	VDE
Voltage	(Hz)	Phase	Poles	UL/CSA	(amps)	(AIC)	(AIC)
65	DC	-	1	.05-50	-	7500	-
65	DC	-	2**	101-150	-	50 000	-
65	DC	-	3**	175-200	-	50000	-
80	DC	-	1	.05-100	.10-100	10000	2000
80	DC	-	1	.05-100	-	50000	-
80	DC	-	2**	125-150	125-150	10000	2000
80	DC	-	3**	175-200	151-200	10000	2000
125	DC	-	1	.05-70	.05-70	5000	3000
125/250	DC	-	2	.05-50	-	5000	-
125	50/60	1&3	1	.05-40	-	10000	-
125	50/60	1&3	1	.05-50	.10-50	5000	2000
120/240	50/60	1	2	.05-70	.10-50	5000	2000
240	50/60	1&3	1	.05-20	-	5000	-

AGENCY APPROVALS - CELHF

DC

80

AGENCY APPROVALS - CEL/CELP (COMMUNICATIONS)

4

				(-			
	Frequency		Min.		VDE	UL 489A	VDE
Voltage	(Hz)	Phase	Poles	UL/CSA	(amps)	(AIC)	(AIC)
65	DC	-	1	.05-50	-	7500	-
65	DC	-	2**	101-150	-	50000	-
80	DC	-	1	.05-100	-	50000	-
80	DC	-	2**	101-200	-	10000	-
80	DC	-	3**	201-250	-	10000	-
125	DC	-	1	.05-70	-	5000	-
80	DC	-	1	15.1-125	-	10000	-

400

10000 AIC

(UL489A)

AGE	AGENCY APPROVALS - IDL/IDLP (MARINE)											
Voltage	Frequency (Hz)	Phase	Min. Poles	тс	OL	UL/CSA	VDE (amps)	UL 1077 & CSA (AIC)	VDE (AIC)			
48	DC	-	1	1	1	.02-100	-	U1, 5000	-			
48	DC	-	2**	1	1	101-150	-	U1, 5000	-			
65	DC	-	1	1	1	.02-60	-	U1, 1000	-			
80	DC	-	1	1	1	.02-100	-	U2, 1500	-			
125	50/60	1	1	1	1	.02-100	-	U 1, 1500	-			
250	50/60	1	2	1	1	.02-100	-	U2, 1500	-			
250	50/60	1&3	1	1	1	.02-60	-	U1, 1000	-			

AGENCY APPROVALS - IULQ (TAPPED COIL)

Voltage	Frequency (Hz)	Phase	Min. Poles	тс	OL	UL/CSA	VDE (amps)	UL 1077 & CSA (AIC)	VDE (AIC)			
125/250	50/60	1	1	1	1	2/1-30/15	-	C2, 5000(1)	-			

AGENCY APPROVALS - IULD (DUST SEALED)

Voltage	Frequency (Hz)	Phase	Min. Poles	тс	OL	UL/CSA	VDE (amps)	UL 1077 & CSA (AIC)	VDE (AIC)
250	50/60	1&3	1	1	1	.02-100	-	C2, 5000(3)	-
277	50/60	1	1	1	1	.02-30	-	C2, 5000(3)	-
	·			·					

Notes: ** Paralleled poles; + 2 poles in series; ++ 3 poles in series; (1) With 125 A max. series fuse; (2) Series combination with 209 or 229 series (100 A max.); (3) With 100 A max. series fuse; (4) With blocked vent construction (5) Non-standard construction. "Fit for further use" approval

General notes:

- All supplementary protectors are of the overcurrent (OC) type
- The family of protectors has been evaluated for end use application for use groups (UG) A, B, C and D
- The terminals (FW) are suitable for factory wiring only (0)
- The maximum voltage ratings for which the protectors have been tested are shown in the chart
- The current is the amperage range that the protectors have been tested
- The tripping current (TC) for all of the protectors is either either "1" (in the range of 125% to 135% of ampere rating) or "2" (more than 135% of ampere rating)
- The overload rating (OL) designates whether the protector has been tested for general use or motor starting applications.
- 0 tested at 1.5 times amp rating for general use
- 1 tested at 6 times AC rating or 10 times DC rating for motor starting
- The short circuit current rating (SC) The short circuit rating in amperes following a letter and number designating the test conditions and any calibration following the short circuit test is defined below:
- $\mathsf{C}-\mathsf{Indicates}$ short circuit test was conducted with series overcurrent protection
- $\mathsf{U}-\mathsf{Indicates}$ short circuit test was conducted without series overcurrent protection
- 1 Indicates a recalibration was not conducted as part of the short circuit testing
- $2-\mbox{Indicates}$ a recalibration was performed as part of the short circuit testing

3- Indicates recalibration was performed along with the dielectric and voltage withstand for "Suitable for Further Use" rating



The ordering code for IAL/IUL/IEL/LEL circuit protectors may be determined by following the decision steps in the appropriate part number decision table subsequent to this page.

The coding given permits a self-assigning part number but with certain limitations. Special applications may require a factory assigned part number. Typical examples are units with mixed ratings, combinations of styles, or constructions not listed in the third decision table, etc. With these, it is suggested that order entry be by description and/or drawings, and a part number will be established. Additionally, it is standard policy to establish a factoryassigned part number whenever a descriptive drawing exists to provide cross reference, traceability and manufacturing control.

When specifying a circuit breaker for AC motor start or high inrush applications, the peak amplitude and surge duration should be specified for factory assistance in rating selection.

For example the code shown is the code for a single pole breaker with a series construction and auxiliary switch, designed for operation in a 50/60Hz circuit. It has a short time delay, rating of 20 amperes and a marked black handle, and is VDE approved.

To determine the ordering number for your particular IAL/IUL/IEL unit, simply follow the steps shown. You may use this number to place an order or as a reference for further questions you may have.

Notes:

165

IEL, IELH and IELX circuit protectors are designed to meet 8mm creepage clearance requirements for installation Category 111, Pollution Degree 3, Case A as measured in IEC 664. Intended for use in equipment to comply with IEC 950, 601 and VDE 0804 & 0805.

Туре	ype and Terminal Description		
141			Termina
IAL **IUL ***IEL	One handle per unit		Standa no des
IALH **IULH ***IELH	One handle per pole	K C B	Stud te Clip ter Bullet t
IALN ***IULN	One handle per unit panel seal		Dullet
IALX **IULX ***IELX	One handle per unit, rocker, bracket mounting		2 Se Po
IALZX **IULZX ***IELZX	One handle per unit, rocker, integral mounting		1 11
*IDL	One handle per unit UL 1500		111
*IDLH	One handle per pole UL 1500		1111 *Not ava Consult f
***IML	One handle per unit mid trip indication		Conduct
***IMLH	One handle per pole mid trip indication		Examp
IALBX **IULBX ***IELBX	One handle per unit, rocker, accidental-off protection		IEL
**IMLBX	One handle per unit, mid trip indication, rocker, accidental-off protection		1

3 Thire	d Decision							
Inter	nal Configuration							
-0	Switch only (50, 70 or 100 amp switch)							
-1	Series							
-1REC4	Series with auxiliary switch* .110 quick connect							
-1REC5	Series with auxiliary switch* .187 quick connect							
-1REG4	Series with auxiliary switch .110 quick connect							
-1RS4	Series with alarm switch, electrical trip, .110 quick connect terminals							
-1RLS4	Series with alarm switch, electrical trip, .110 quick connect terminals (mid-trip only)							
-1RS5	Series with alarm switch, electrical trip, .187 quick connect terminals							
-3	Shunt							
-4	Relay (not available in IEL/IELX)							
pole units.	uxiliary switch is normally supplied on two or three Switch is located in the right-hand pole (viewed from d) unless otherwise specified.							

C = CCC Approved

This approval requires the addition of a C at the end of the part number. The unit will not be VDE Approved.

Note: CCC Approval is pending.

	Territ	IIIdi	
		dard screw terminal, esignation required	
к		terminals	
c		terminals	
в		et terminals	
	_		
Г	2	Second Decision	
		Poles	
	1	Single pole	
	11	Two pole	
	111	Three pole	
	1111	Four pole*	
		available in toggle seal handle type. Ilt factory for 5 and 6 pole IEL part number.	
	Exam	nple:	
	IEL	1 - 1REC4- 61- 20.0 - 01 - V	
	<u> </u>		
Γ			
	4	Fourth Decision	
		Frequency & Delay	
	SW	Switch only	
Z	-41	400Hz short delay	
4	-42	400Hz long delay	
	-43	400Hz motor start	
	-49	400Hz 150% instant trip	
	-51	DC short delay	
_	-52	DC long delay	
	-53	DC motor start	
	-59	DC 125% instant trip	
_	-61	50/60Hz short delay	
	-62	50/60Hz long delay	
	-63	50/60Hz motor start	
	-69	50/60Hz 125% instant trip	
	-71	DC/60Hz short delay	
	-72	DC/60Hz long delay	
	-73	DC/60Hz motor start	
-	-79	DC/60 Hz 135% instant trip	
		ddition of inertial delay, add an ìFì to any numeral.	
1			
	V =	VDE and CCC Approved	
		haded areas denote VDE and CCC blicable) Approval options.This approval	
\neg	requir	es the addition of a V at the end of the umber. The V will be added to any part	
╡	numb	er formed entirely from shaded decisions. -shaded areas are selected, the unit will not	
d.		E or CCC Approved, but other approvals	

Note: CCC Approval is pending.

still apply

5 Fifth Decision Rated Current

7

Color

Black

Yellow

Red

Blue

Green

Orange

White

Use three numbers to print required current value between **.100** amps minimum and **100** amps maximum.

For example, use: .100 or 2.00 or 10.0 The VDE (Ith) will be 95% of the UL/CSA rated current.

Seventh Decision

IAL, IUL, IEL, IALH, IULH, IELH - Toggle Handle

Handle Color and Marking Selection

Unmarked

-00

-10

-20

-30

-40

-60

-90

Marked* ON-OFF

I-0 -01 (STD)

-11

-21

-31


-41

-61

-91

6	Sixth Decision
	Optional
	Standard hardware. No designation required.
-A	Metric thread mounting inserts and terminals
-В	Barrier
-C	277V (50/60Hz only) (See note 3)
-D	240/415V (50/60Hz only)
-E	277V/480V (50/60Hz only) (See note 4)
-G	Handle guard, (available in ZX, BX and snap-in versions only)
-К	1/4 - 20 stud (M6 stud when -A option is selected) (<=70A requires -K, if >70A do not use -K)
۰L	Handle lock
-M	Handle in opposite pole
-P	Snap-in face plate adapter
-U	120/240V 50/60Hz
-W	Wire clamp supplied (VDE approved up to and including 16.0 amps)
-X	Handle guard with no actuation feature (BX rocker only)
-1	Silver 5/16" (.312") bullet
-2	Gold 5/16" (.312") bullet
Notes	

- Invotes: 1. One or more descriptions may be used as required. 2. When this is not used, table one may be substituted and U.S. thread and two lockwashers will be supplied. Unit will be rated at 250V (50/60Hz only.) 3. VDE approved at 250Va 4. VDE approved at 415Vac



MARKING DETAIL "A" (SEE TABLE)






۹ INDICATION "OFF" Mounting/Indicator Code: M, N, P, R ON LINE LOAD LINE FIG 3 EIG 6

MARKING DETAIL "C" (SEE TABLE)

КОСК	er Handle Color	, Indicator Col	or and Marking	g Selection (See	e Notes)						
IALX	, IULX, IELX, IA	LZX, IULZX, IE	ELZX Rocker Ha	andle (Single R	ocker Color)					
					Vertical	Mounting		Horizonta	al Mounting	1	
Rocker Handle Color	Indicating Color	Marking Color	Indicates:	Unmarked	On-Off Fig.1	I-O Fig.2	On-Off I-O Fig.3	On-Off Fig.4	I-O Fig.5	On-Off I-O Fig.6	Marking Detail
Black	N/A	White	N/A	-00	-01	-02	-03	-04	-05	-06	
Red	N/A	White	N/A	-20	-21	-22	-23	-24	-25	-26	1
Grey	N/A	Black	N/A	-40	-41	-42	-43	-44	-45	-46	A
Orange	N/A	Black	N/A	-50	-51	-52	-53	-54	-55	-56	1
White	N/A	Black	N/A	-90	-91	-92	-93	-94	-95	-96	1
IALZ	X, IULZX, IELZX	Rocker Handle	(Dual Rocker Co	olor)							
Black	White	White	On	-A0	-A1	-A2	-A3	-A4	-A5	-A6	
Black	Red	White	On	-B0	-B1	-B2	-B3	-B4	-B5	-B6	1
Black	Green	White	On	-C0	-C1	-C2	-C3	-C4	-C5	-C6	A
Black	White	White	Off	-F0	-F1	-F2	-F3	-F4	-F5	-F6	1
Black	Red	White	Off	-G0	-G1	-G2	-G3	-G4	-G5	-G6	1
Black	Green	White	Off	-H0	-H1	-H2	-H3	-H4	-H5	-H6	
Black	White	White	On	-J0	-J1	-J2	-J3	-J4	-J5	-J6	
Black	Red	White	On	-ко	-K1	-K2	-КЗ	-K4	-K5	-K6	В
Black	Green	White	On	-L0	-L1	-L2	-L3	-L4	-L5	-L6	1 -
IALB>	K, IULBX, IELBX,	LELBX Rocker H	landle (Dual Roo	ker Color)							· · · · ·
Black	White	White	Off	-M0	N/A	-M2	-M3	N/A	N/A	-M6	
Black	Red	Red	Off	-N0	N/A	-N2	-N3	N/A	N/A	-N6	1
Black	Green	Green	Off	-P0	N/A	-P2	-P3	N/A	N/A	-P6	- C
Black	Yellow	Yellow	Off	-R0	N/A	-R2	-R3	N/A	N/A	-R6	



LEL DECISION TABLES

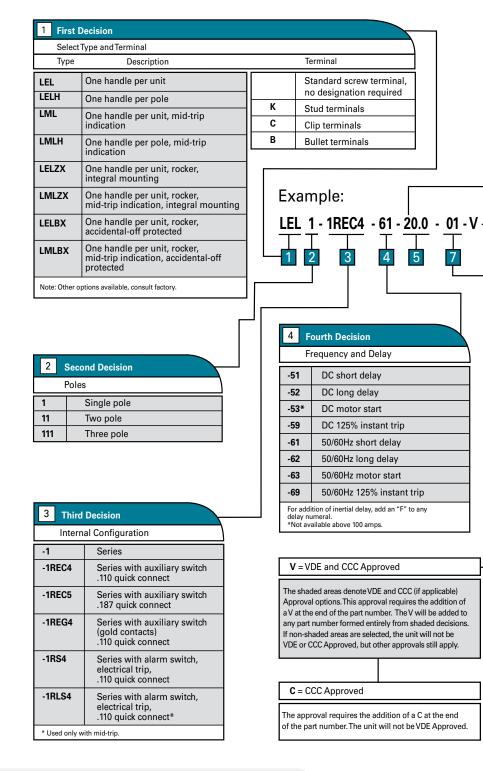

5 Fifth Decision

Rated Current

Use three numbers to print (.050 or 1.50 or 100) Value between .**050** amps and **100** amps.

	Optional								
-A	Metric thread mounting inserts and terminals								
-В	Barrier								
-F	240V 50/60Hz								
-G	Handle guard, (available in ZX, BX and snap-in versions only)								
-К	1/4 - 20 Stud (M6 Stud when -A option is selected) (50A requires -K, >50A do not use -K)								
-L	Handle Lock								
-M	Handle in opposite pole								
-P	Snap-in mounting plate adapter								
-U	120/240Vac, 5000 A.I.C., 70A max. 2 pole only with barrier (VDE 250Vac)								
-V	125VDC								
-X	Handle guard with no actuate "off" feature (see detail C)								
-1	Silver 5/16" (.312") bullet								
-2	Gold 5/16" (.312") bullet								
2.Wh sub	: e or more descriptions may be used as required. en this decision is not used, decision 7 may be stituted and U.S. thread will be supplied. 15 or M6) studs are required, use "A" only on an LELK.								
	Counth Desision								
7	Seventh Decision								
7	Seventh Decision LEL Toggle Handle Color Selection								
7	LEL Toggle Handle Color Selection								
	LEL Toggle Handle Color Selection Black w/ white markings								
-01	LEL Toggle Handle Color Selection Black w/ white markings Yellow w/ black markings								
-01 -11	LEL Toggle Handle Color Selection Black w/ white markings Yellow w/ black markings Red w/ white markings								
-01 -11 -21	LEL Toggle Handle Color Selection Black w/ white markings Yellow w/ black markings								
-01 -11 -21 -31	LEL Toggle Handle Color Selection Black w/ white markings Yellow w/ black markings Red w/ white markings Blue w/ white markings								
-01 -11 -21 -31 -41	LEL Toggle Handle Color Selection Black w/ white markings Yellow w/ black markings Red w/ white markings Blue w/ white markings Green w/ white markings								

Handles.

Notes: The LEL family of circuit breakers are designed to meet 8mm creepage and clearance requirements for installation Category 111, pollution degree 3, Case A as measured in IEC 664. Intended for use in equipment designed to comply with IEC 380, 435, 601 AND VDE 0730, 0804 & 0805.

167


7 Seventh Decision

Rocker Handle Color, Indicator Color and Marking Selection	n (See Notes)
--	---------------

LELZX & LMLZX Rocker Handle (Single Rocker Color)

					Vertical	Vertical Mounting			Horizontal Mounting		
Rocker Handle Color	Indicating Color	Marking Color	Indicates:	Unmarked	On-Off Fig.1	I-O Fig.2	On-Off I-O Fig.3	On-Off Fig.4	I-O Fig.5	On-Off I-O Fig.6	Marking Detail
Black	N/A	White	N/A	-00	-01	-02	-03	-04	-05	-06	
Red	N/A	White	N/A	-20	-21	-22	-23	-24	-25	-26	A
Grey	N/A	Black	N/A	-40	-41	-42	-43	-44	-45	-46	
Orange	N/A	Black	N/A	-50	-51	-52	-53	-54	-55	-56	
White	N/A	Black	N/A	-90	-91	-92	-93	-94	-95	-96	
LELZ	X & LMLZX Roo	ker Handle (Dua	I Rocker Color)					-			
Black	White	White	On	-A0	-A1	-A2	-A3	-A4	-A5	-A6	A
Black	Red	White	On	-B0	-B1	-B2	-B3	-B4	-B5	-B6	
Black	Green	White	On	-C0	-C1	-C2	-C3	-C4	-C5	-C6	
Black	White	White	Off	-F0	-F1	-F2	-F3	-F4	-F5	-F6	1
Black	Red	White	Off	-G0	-G1	-G2	-G3	-G4	-G5	-G6	1
Black	Green	White	Off	-H0	-H1	-H2	-H3	-H4	-H5	-H6	
Black	White	White	On	-J0	-J1	-J2	-J3	-J4	-J5	-J6	
Black	Red	White	On	-K0	-K1	-K2	-K3	-K4	-K5	-K6	В
Black	Green	White	On	-L0	-L1	-L2	-L3	-L4	-L5	-L6	1
LELB	X Rocker Handle	(Dual Rocker Co	lor)			•			•	•	
Black	White	White	Off	-M0	N/A	-M2	-M3	N/A	-M5	-M6	
Black	Red	Red	Off	-N0	N/A	-N2	-N3	N/A	-N5	-N6	1
Black	Green	Green	Off	-P0	N/A	-P2	-P3	N/A	-P5	-P6	C
Black	Yellow	Yellow	Off	-R0	N/A	-R2	-R3	N/A	-R5	-R6	1


B. Consult factory for other marking options.





MARKING DETAIL "A" (SEE TABLE)





MARKING DETAIL "B" (SEE TABLE)




INDICATION "OFF" Mounting/Indicator Code: M, N, P, R



MARKING DETAIL "C" (SEE TABLE)

CEL DECISION TABLES

::: Sensata

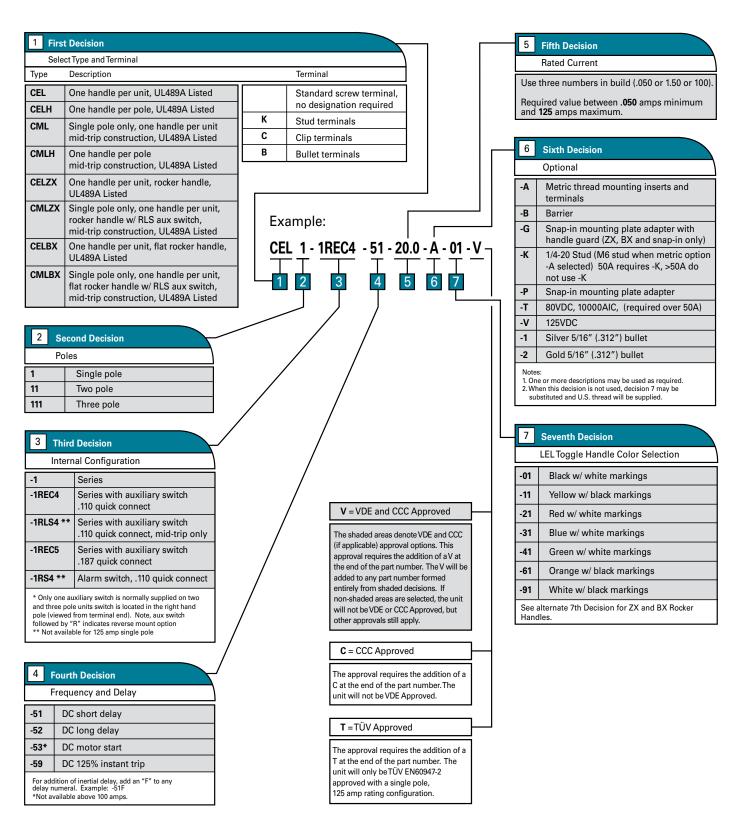

169

7 Seventh Decision


Г

Rocker Handle Color, Indicator Color and Marking Selection (See Notes)

LELZX & LMLZX Rocker Handle (Single Rocker Color)

					Vertical	Mounting		Horizonta	al Mounting		
Rocker Handle Color	Indicating Color	Marking Color	Indicates:	Unmarked	On-Off Fig.1	I-O Fig.2	On-Off I-O Fig.3	On-Off Fig.4	I-O Fig.5	On-Off I-O Fig.6	Marking Detail
Black	N/A	-00	-01	-02	-03	-04	-05	-06			
Red	N/A	White	N/A	-20	-21	-22	-23	-24	-25	-26	A
Grey	N/A	Black	N/A	-40	-41	-42	-43	-44	-45	-46	
Orange	N/A	Black	N/A	-50	-51	-52	-53	-54	-55	-56	
White	N/A	Black	N/A	-90	-91	-92	-93	-94	-95	-96	
LELZ	X & LMLZX Roc	ker Handle (Dua	I Rocker Color)								
Black	White	White	On	-A0	-A1	-A2	-A3	-A4	-A5	-A6	
Black	Red	White	On	-B0	-B1	-B2	-B3	-B4	-B5	-B6	A
Black	Green	White	On	-C0	-C1	-C2	-C3	-C4	-C5	-C6	
Black	White	White	Off	-F0	-F1	-F2	-F3	-F4	-F5	-F6	
Black	Red	White	Off	-G0	-G1	-G2	-G3	-G4	-G5	-G6	
Black	Green	White	Off	-H0	-H1	-H2	-H3	-H4	-H5	-H6	
Black	White	White	On	-J0	-J1	-J2	-J3	-J4	-J5	-J6	
Black	Red	White	On	-К0	-K1	-K2	-K3	-K4	-K5	-K6	В
Black	Green	White	On	-L0	-L1	-L2	-L3	-L4	-L5	-L6	
LELB	X Rocker Handle	Dual Rocker Co	lor)					_			
Black	White	White	Off	-M0	N/A	-M2	-M3	N/A	-M5	-M6	
Black	Red	Red	Off	-N0	N/A	-N2	-N3	N/A	-N5	-N6	
Black	Green	Green	Off	-P0	N/A	-P2	-P3	N/A	-P5	-P6	C
Black	Yellow	Yellow	Off	-R0	N/A	-R2	-R3	N/A	-R5	-R6	1

B. Consult factory for other marking options.











LELHP DECISION TABLES


1 First	t Decision					V = V	DE Approved
Sele	ct Type with Stud Terminals			۱ I		The sha	ded areas denote VDE approval
ELPK	One handle per unit			i l		options.	This approval requires the
MLPK	One handle per unit, mid-trip			1			of a V at the end of the part The V will be added to any par
ELZXPK	One ZX rocker handle per unit (integ	aral mounti	ing)	1		number	formed entirely from shaded
MLZXPK		<u> </u>	0,	1			ns. If non-shaded areas are I, the unit will not be VDE
ELBXPK	One BX rocker handle per unit (integ		•	1		approve	ed, but other approvals still appl
MLBXPK		•		Examp	le:		
ELHPK	One handle per pole						M
MLHPK	One handle per pole, mid-trip				<u>K 11 - 1REC4 - 51 - 125 /</u>	<u> </u>	- <u>v</u>
	le handle per unit on 125A to 150A units (2-; 200A (3-parallel pole) requires handle in each					5 7	
2 Seco	ond Decision s			-			
1	Two pole (up to 150 amps)		/				
1	Three pole (160 to 200 amps)						
	rd Decision rnal Configuration	-51		Delay rt delay (125 to 150 amp)	5 Fifth Decision Rated Current (Amps) 125.	-01	Seventh Decision Toggle Handle Color Black w/ white marking
1	Series		-	rt delay (160 to 200 amp)	130.	-11	Yellow w/ black marking
IREC4	Series with auxiliary switch	-52	DC 125% long	g delay (125 to 150 amp)	135.	-21	Red w/ white markings
	.110 quick connect		DC 135% long	g delay (160 to 200 amp)	150.	-31	Blue w/ white markings
IREG4	Series, aux switch (gold contacts)	-59	DC 125% insta	ant trip (125 to 150 amp)	175.	-41	Green w/ white markin
	.110 quick connect	-55	DC 135% insta	ant trip (160 to 200 amp)	200.	-61	Orange w/ black markir
IRLS4	Series with alarm aux switch .110 quick connect, mid-trip only			al delay, add an "F" to any	Additional ratings available.	-91	White w/ black marking
RLSG4	Series, alarm aux switch (gold contacts), .110 quick connect,	dela	y option. Example	e: - 59 becomes -59F			LEL alternative 7th decision & BX rocker handles
	mid-trip only	6	Sixth Decision	n	\sim		
RS4	Series with alarm aux switch		Optional (leav	ve entry blank if none apply)			
	.110 quick connect	-A	Metric thread	d mounting inserts and termi	nals		
IREC5	Series with aux switch	-G			dle guard (ZX, BX & snap-in only)		
	.187 quick connect	-X	Handle guard	d with no actuate off feature (BX only, no mid-trip)		
IRLS5	Series with alarm aux switch	-P	-	nting plate adapter			
1RS4	.187 quick connect, mid-trip only Series with alarm aux switch	Note 1. Or	s: e or more descrip	tions may be used as required.	ostituted and U.S. thread will be supplied.		
	187 quick connect	2. 00	ion una decisión is	s not used, decision / may be su	ostrated and 0.5. thread will be supplied.		

.187 quick connect

-1RS5

Series with alarm aux switch .187 quick connect, mid-trip

CELHP DECISION TABLES

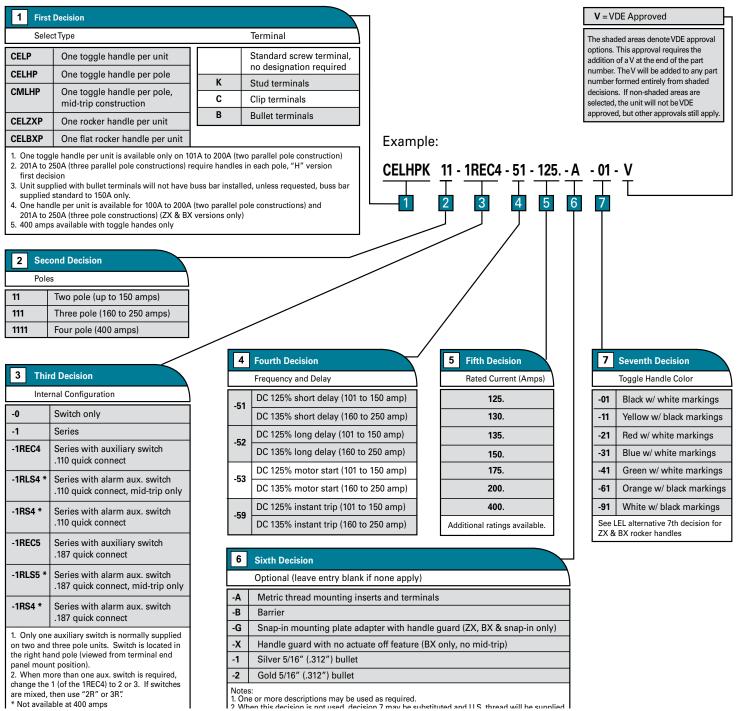

* Not available at 400 amps

Mouser Electronics

Authorized Distributor

Click to View Pricing, Inventory, Delivery & Lifecycle Information:

Sensata:

IALHK1111-40426-1 IULNK11-35544-100 LMLB1-1RLS4-35530-15-V LMLB1-1RLS4R-36825-25-V LELBX1-35132-15-V IULN0-0 IELK111-28967-1V IULXB1-1REC4-39287-20 IULN1-1REC4-39621-15X IULHK1111-4R-38342-3010 IULX111-1-61-20.0-42 IULXB1-1REC4-39287-15 IULXB1-1REC4-39287-40 IULHR11-0-C-11 IULK11-0-100.-01 IULX111-1-61-40.0-42 IDLNK21-1REC5-38140-30-G1 IMLR11-1-52-10.0-01 IULHK111-1REC4-40767-16 IULHK11-1REC4-37893-1 IULHK11-1REC4-41012-63 IULHK11-1REC4-41043-32 IULZXB1-1REC4-71429-16 IELX1-1-51-20.0-23-V IELX1-1-51-6.00-53-V IELX1-1-51-6.00-93-V IELX1-1-51-7.50-43-V LELB11-1-63-20.0-1-01 LELHB11-1-63-50.0-F1-01 LELHB11-40373-10 IELX111-1-61-30.0-AE-03-V IDLHK111-224-63 IELX111-1-62-35.0-05-V IELX11-1-62-25.0-AE-22-V LMLK111-1-61-20.0-FK-91 LMLK111-1-61-15.0-FK-91 IMLK11-1-52-1.00-01-V IMLK11-1-52-16.0-01-V IDLK1-224-53 IELX111-1-61-25.0-AE-01 IELXK111-30442-1-V IELXK111-30442-2-V IELXK111-1-62-20.0-A-02-V IELX11-1-62-2.50-E-03 IELX1-1-51-40.0-01 IML11-1-51-15.0-91 IALNK111-1-41-15.0 IALNK111-1-41-2.00 CELBXK1-1REC4-33650-100 LMLK1-1RLS4-52-100.-T-01 IULNK111-2REC4-40499-100 IALK1-1REC4-38929-35 IELB1-1REC5-70301-15 IALHK111-1REC4-38931-37 IALHK111-1REC4-38931-40 IALHK111-2REC4-38931-16X IALHK111-1REC4-38931-30 IELHB11-1REC5-70313-15 IALK1-1REC4-38929-20 IALHK111-1REC4-38931-25 IMLK1-39660-60-V IDLNK21-1REC5-38952-50-G1 IDLK12-1REC5-38953-30-G1 IDLK12-1REC5-38953-50-G1 IDLNK21-1REC5-38952-30-G1 IALK1-39178-15 IALK1-39181-15 IALHK11-39185-10 IALHK11-39187-10 IALHK11-39193-50 LELBXK1-37030-100-V LELH111-36804-2-V LELH11-36815-1-V CMLBXPK111-1RLS4-36933-250-V IDLN21-1REC5-38944-2-G1 LMLZXPK11-1REC4-52-125.-03-V LMLBXPK11-71289-150 LELZXK111-1REC4-71210-100 LELK1-1REC5-37547-15-V LELK1-1REG4R-62-5.00-01-V LELHPK11-1REC4-39486-125-V LELB1-1REC4-40335-100-V IULNK11-1REC4-40505-75 IMLK1-1REG4-40705-15 IMLHK11-1REC4-71371-15 IMLHK111-1REG4-40958-45 IELK1-1REC4-40628-25-V IELK1-1REC4-40628-35-V IELHK11-1REC5-70299-100 IELHK111-1REC5-71336-15-V IELB1-1REC5-70309-25 IALK1-1REC4-71370-R5 CELHK11-1REC5-71336-16-V IULHK12-1RS4-27759-5 IELXK1-1REC4-51-40.0-03-V IELHB11-1REC5-70302-0.5 IELB1-1REC5-70301-25 IELXK1-1REC4-51F-90.0-03-V IELXK1-1REC4-52-40.0-03-V IELXK1-1REC4-52-90.0-03-V