


PANDUIT PART NUMBER	PKG.	STUD SIZE	DIMENSIONS in.				
			A $\pm .03$	W $\pm .01$	C $\pm .02$	M $\pm .03$	H $\pm .01$
P2-10R	-X -T	#10	1.46 (.37, 1)	.68 (.17, .3)	.58 (.14, .7)	1.12 (.28, .5)	.20 (.5, 1)
P2-14R	-X -T	1/4"	1.46 (.37, 1)	.68 (.17, .3)	.58 (.14, .7)	1.12 (.28, .5)	.27 (.6, .9)
P2-56R	-X -T	5/16"	1.46 (.37, 1)	.68 (.17, .3)	.58 (.14, .7)	1.12 (.28, .5)	.33 (.8, .4)
P2-38R	-X -T	3/8"	1.46 (.37, 1)	.68 (.17, .3)	.58 (.14, .7)	1.12 (.28, .5)	.39 (.9, .9)
P2-12R *	-X -T	1/2"	1.55 (.39, .4)	.86 (.21, .8)	.58 (.14, .7)	1.12 (.28, .5)	.52 (.13, .2)

1. UL LISTED AND CERTIFIED FOR:
A. 347° F (175° C) MAX OPERATING TEMP
B. #2 AWG STRANDED COPPER WIRE
2. PACKAGE QTY: STD. PKG.-X=10
BULK PKG.-T=200
3. MATERIAL: .060" (1,52) THK COPPER, TIN PLATED
4. DIMENSIONS IN BRACKETS ARE IN MILLIMETERS
5. INSTALLATION TOOL: CT-700 (OBSOLETE), CT-1701
6. WIRE STRIP LENGTH: 7/16 ^{+1/32}₋₀ (11,11 ⁺⁸₋₀)

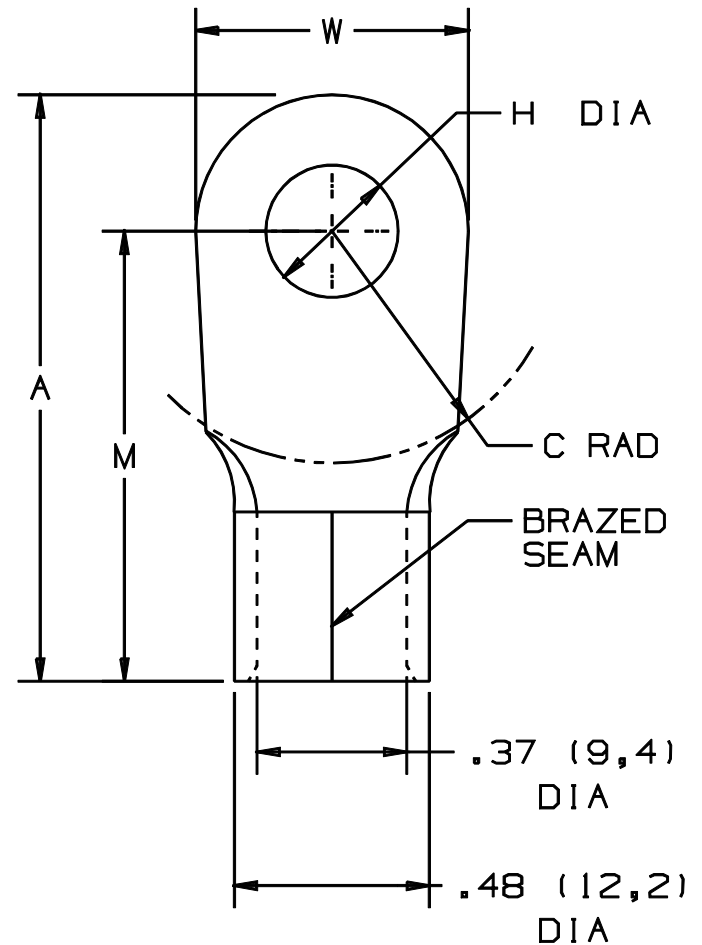

A41212_03

								P PANDUIT CORP. TINLEY PARK, ILLINOIS					
03	3/01	EJS		ADDED PACKAGE CODE TO CHART, ADDED CT-1701, ADDED "OBSELETE" TO NOTE 5, FILE SPEC WAS N41212AA_PCD_02, METRIC DIM. WERE 2 PLACES						#2 BARREL NON-INSULATED RING TONGUE			
02	11/94	TH	RLS	UPDATED NOTES AND DIMENSIONS			02669	LA	TFKE				
1	7-88	DW		REDRAWN WITH REVISIONS									
REV	DATE	BY	CHK	DESCRIPTION			ECN #	CUST	PM	DRAWN BY DAW	Ck'd RLS	SCALE NONE	DRAWING NO. A41212

Mouser Electronics

Authorized Distributor

Click to View Pricing, Inventory, Delivery & Lifecycle Information:

Panduit:

[P2-10R-T](#) [P2-10R-X](#) [P2-38R-T](#) [P2-38R-X](#) [P2-56R-X](#) [P2-14R-T](#) [P2-14R-X](#) [P2-12R-T](#) [P2-56R-T](#) [P2-12R-X](#)